Model 375XL

Reduced Pressure Principle Assembly

## Application

Ideal for use where Lead-Free\* valves are required. Designed for installation on potable water lines to protect against both backsiphonage and backpressure of contaminated water into the potable water supply. Assembly shall provide protection where a potential health hazard exists.

#### **Standards Compliance**

- ASSE® Listed 1013
- IAPMO® Listed
- CSA® Certified B64.4
- AWWA compliant C511
- · Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California
- UL® Classified (less shut-off valves only, 3/4"-2")
- C-UL® Classified (less shut-off valves only, 3/4"-2")
- Meets the requirements of NSF/ANSI 61\*

\*(0.25% MAX. WEIGHTED AVERAGE LEAD CONTENT)


## **Materials**

Housing	Reinforced Nylon, FDA approved
Fasteners	Stainless Steel, 300 Series
Elastomers	Silicone (FDA Approved)
	Buna Nitrile (FDA Approved)
Internals	Delrin, Nylon
Springs	Stainless Steel, 300 series
Ball Valves	Low Lead Cast Bronze, ASTM B 584
Struts	Stainless Steel, 300 Series

#### **Features**

1/2", 3/4", 1", 1-1/4", 1-1/2", 2" Sizes: Maximum working water pressure Maximum working water temperature Hydrostatic test pressure End connections Threaded FNPT

175 PSI 180°F 350 PSI ANSI B1.20.1

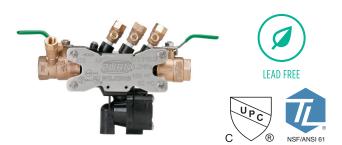

# Options


(Suffixes can be combined)

- $\square$ with full port QT ball valves (standard)
- with Model SXL lead-free bronze "Y" type strainer
- □ FT with integral male 45° flare SAE test fitting
- □ AG - with air gap
- □ SAG with Model SXL lead-free bronze "Y" strainer and air gap
- □В - with black fusion epoxy coated ball valves & struts for theft protection

#### Accessories

- Repair kits
- □ Thermal expansion tank (Mdl. XT)
- □ Soft seated check valve (Mdl. 40XL2)
- □ Shock arrester (Model 1260XL)
- □ QT-SET Quick Test Fitting Set
- □ Blow out / Flush fitting (RK34-375BOF (1/2" or 3/4"), RK1-375BOF or RK114-350-375BOF)

### **MODELS 375XLSE**




## Dimensions & Weights (do not include pkg.)

			DIMENSIONS (approximate)																		
MODEL 375XL SIZE		А		В		с		D		E		F		G		н		J		WEIGHT	
in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	in.	mm	lbs.	kg
1/2	20	8 7/8	225	1 15/16	49	1 3/8	35	2 15/16	75	3 7/8	98	12 1/4	311	3	76	10 7/8	276	12 1/4	311	5.7	2.6
3/4	20	8 7/8	225	1 15/16	49	1 3/8	35	2 15/16	75	3 7/8	98	12 5/8	321	3	76	11	279	12 1/4	311	5.7	2.6
1	25	11 3/16	284	2 1/4	57	1 13/16	46	3 7/16	87	4	102	14 9/16	370	4	102	13 3/4	349	15 1/4	387	9.7	4.4
1-1/4	32	14 7/8	378	3 3/8	86	3 1/8	80	3 3/4	95	5 3/4	146	20 1/2	521	3 3/4	95	18	457	18 1/2	470	20.5	9.3
1-1/2	40	15 1/4	387	3 3/8	86	3 1/8	80	3 3/4	95	5 3/4	146	22	559	4 1/2	114	18 3/4	476	20 1/4	514	21.5	9.8
2	50	16	406	3 3/8	86	3 1/8	80	3 3/4	95	5 3/4	146	24	610	4 3/4	120.7	20 3/4	527	20 3/4	527	23.5	10.7

Rev. N Date: 12/19 Document No. BF-375XL Patent No. 6, 513, 543, 7,784,483, & 7,905,250 Product No. Model 375XL




## MODEL 375XL 1/2" - 1" (STANDARD & METRIC)

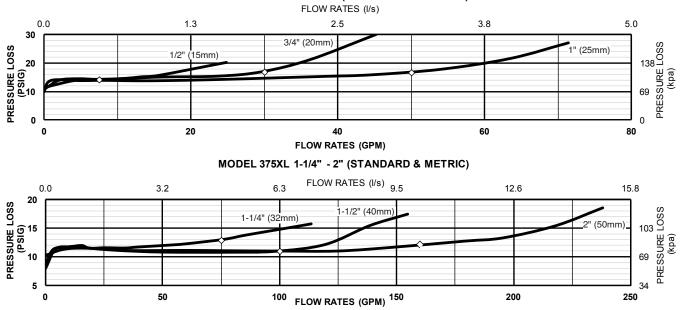


## **Typical Installation**

Local codes shall govern installation requirements. To be installed in accordance with the manufacturers' instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

Relief Valve Discharge Rates

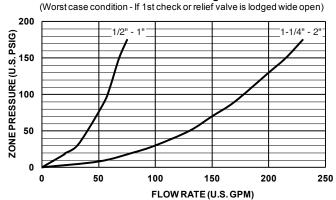

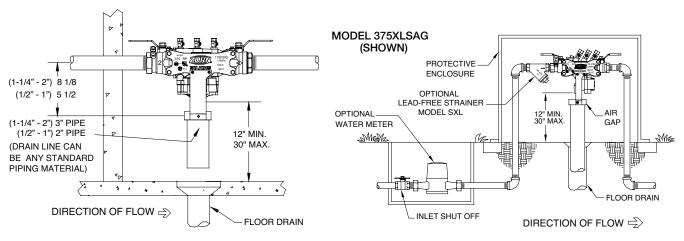

## INDOOR INSTALLATION

## OUTDOOR INSTALLATION

## Specifications

The Reduced Pressure Principle Backflow Preventer shall be certified to NSF/ANSI 61, ASSE® Listed 1013, rated to 180°F, and supplied with full port ball valves. The main body shall be Nylon and the seat disc elastomers shall be silicone. If installed indoors, the installation shall be supplied with an air gap adapter. The Reduced Pressure Principle Backflow Preventer shall be a ZURN WILKINS Model 375XL.